


* RESIDENTIAL SIDEWALK SPECIFICATIONS *

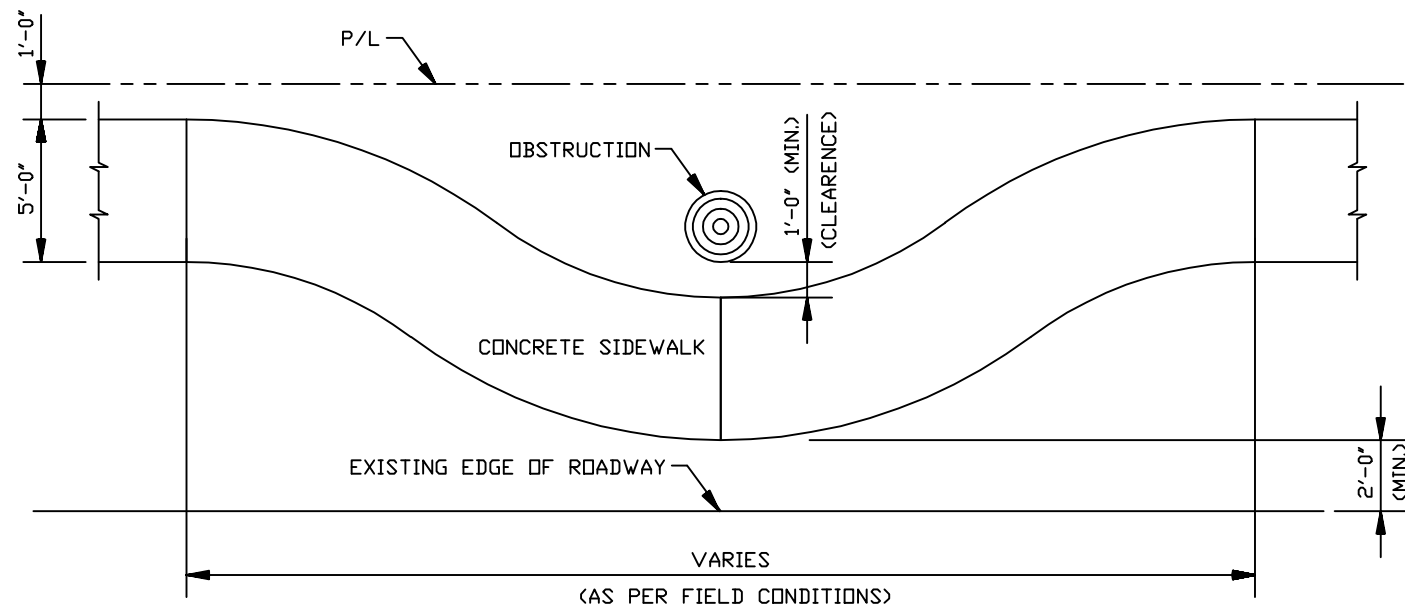


TYPICAL DETAIL FOR GOING AROUND
SIDEWALK OBSTRUCTION
(N.T.S.)

1. CONTACT THE DEPARTMENT OF ENGINEERING AT (504) 349-5173 PRIOR TO BEGINNING ANY SIDEWALK CONSTRUCTION. ANY DEVIATION FROM STANDARD DETAILS AND SPECIFICATIONS WILL NEED THE APPROVAL OF THE DIRECTOR OF ENGINEERING.
2. ALL SIDEWALKS SHALL BE CONSTRUCTED OF PORTLAND CEMENT CONCRETE AND HAVE A COMPRESSIVE STRENGTH OF TWENTY-FIVE HUNDRED (4000) POUNDS PER SQUARE INCH IN FOURTEEN (14) DAYS.
3. ALL (PCC) SIDEWALKS SHALL HAVE A MINIMUM THICKNESS OF FOUR (4) INCHES.
4. ALL (PCC) SIDEWALKS SHALL BE CONSTRUCTED AT A DISTANCE OF ONE (1) FOOT FROM THE PROPERTY LINE UNLESS OTHERWISE ALLOWED BY THE DIRECTOR OF THE DEPARTMENT OF ENGINEERING.
5. ALL (PCC) SIDEWALKS SHALL HAVE A MINIMUM WIDTH OF FIVE (5) FEET.
6. ALL (PCC) SIDEWALKS SHALL BE SCORED AT FOUR (4) FOOT INTERVALS TO A DEPTH OF 3/4".
7. ALL (PCC) SIDEWALK SHALL HAVE EXPANSION JOINTS NO FURTHER APART THAN TWENTY (20) FEET. EXPANSION JOINTS SHALL BE CONSTRUCTED OF THREE-FOURTH INCH TREATED (ROT-RESISTANT) TIMBER, OR REDWOOD WITH MINIMUM OF (3) NO. 3 SMOOTH DOWEL BARS. (LENGTH = 12")
8. ALL (PCC) EDGES SHALL BE TOOLED TO ONE-FOURTH (1/4) INCH RADIUS.
9. NO OBSTRUCTIONS OR OPEN GRATES FOR DRAIN LINES WILL BE ALLOWED IN SIDE WALK OR R.O.W. (SEE DETAIL FOR GOING AROUND OBSTRUCTIONS.)
10. HANDICAPPED RAMPS AT CORNERS WILL BE CONSTRUCTED WITH DETECTABLE WARNINGS CONSISTING OF TRUNCATED DOMES. (SEE TYPICAL DETAILS.)
11. TRANSITION RAMPS CONSTRUCTED WHERE NEW SIDEWALK MEETS EXISTING SIDEWALK SHALL HAVE A MAXIMUM SLOPE OF 8%, (1" DROP EVERY 12"). NOT TO EXTEND A RISE GREATER THAN 6 INCHES IN 6 FEET. SUCH RAMPS SHALL NOT EXTEND BEYOND THE PROJECTED SIDE PROPERTY LINES AND SHALL HAVE AN EXPANSION JOINT AT TOP OF SLOPE. PLACE EXPANSION JOINT AT BOTTOM OF SLOPE, IF POSSIBLE. (SEE ELEVATION VIEW "A").


* FOR CONSTRUCTION OF SIDEWALKS ON PUBLIC RIGHT-OF-WAY WHICH TIE TO AN EXISTING ROADWAY WITHOUT AN EXISTING CURB, ELEVATION REQUIREMENTS MUST BE DETERMINED BY THE DEPARTMENT OF ENGINEERING. CONTACT THE DEPARTMENT AT (504) 349-5173 TO ARRANGE FOR DETERMINATION OF THE ELEVATION REQUIREMENTS.

NOTED:

PRE-POUR INSPECTIONS ARE REQUIRED. CALL THE DEPARTMENT OF ENGINEERING AT 504-349-5173 FOR APPOINTMENT.

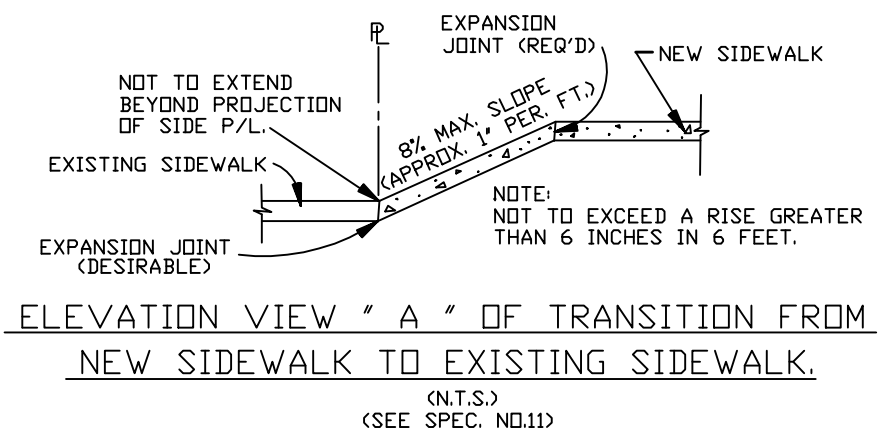

ELEVATION VIEW " A " OF TRANSITION FROM
NEW SIDEWALK TO EXISTING SIDEWALK.
(N.T.S.)
(SEE SPEC. NO.11)

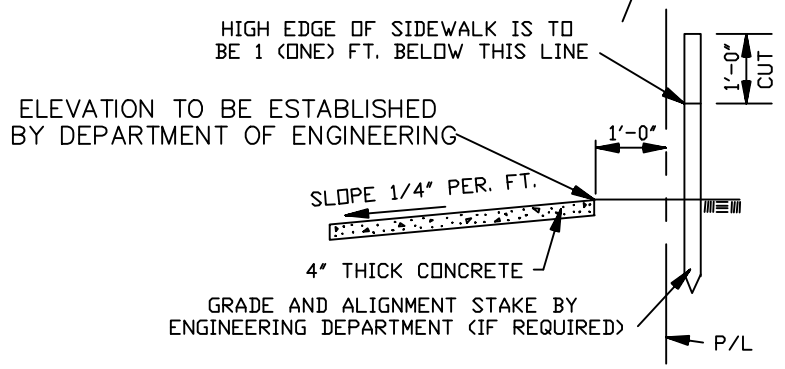

TYPICAL SECTION
(NO CURB)
(N.T.S.)

JEFFERSON PARISH DEPARTMENT OF ENGINEERING			
DRAWING TITLE STANDARD RESIDENTIAL SIDEWALK DETAILS			
DRAWN BY:	CH.S.	DATE:	06/11/04
CHECKED BY:	H.J.W.	DATE:	07/29/04
REVISED BY:	C.H.S.	DATE:	02/09/07
REVISED BY:	P.S.	DATE:	02/09/07
REVISED BY:	J.L.	DATE:	06/01/07
REVISED BY:	J.L.	DATE:	08/07/07
REVISED BY:	J.L.	DATE:	05/12/08
REVISED BY:	P.S.	DATE:	05/12/08
REVISED BY:	C.J.	DATE:	05/13/11
REVISED BY:	C.J.	DATE:	05/24/15
REVISED BY:	J.W.	DATE:	01/20/16
REVISED BY:	C.H.S.	DATE:	11-19-18
FILE NUMBER:	AUTOCAD 2008 VIM RESIDENTIALSIDEWALK.DWG		
ENV-09	SHEET NO. 1 OF 2		